

Report

Laboratory for Acoustics

Determination of the sound absorption (reverberation room method) and the sound insulation of a noise barrier type **NoiStop Green, manufacturer RockDelta A/S (Rockwool A/S)**

Reportnumber A 2151-2E-RA d.d. 12 juli 2011

Member ONRI
ISO-9001: 2000 certified



Peutz bv
Lindenlaan 41, Molenhoek
Postbus 66, 6585 ZH Mook
Tel. (024) 357 07 07
Fax (024) 358 51 50
info@mook.peutz.nl
www.peutz.nl

Peutz bv
Paletsingel 2, Postbus 696
2700 AR Zoetermeer
Tel. (079) 347 03 47
Fax (079) 361 49 85
info@zoetermeer.peutz.nl
www.peutz.nl

Peutz bv
L. Springerlaan 37, Groningen
Postbus 7, 9700 AA Groningen
Tel. (050) 520 44 88
Fax (050) 526 31 78
info@ groningen.peutz.nl
www.peutz.nl

Peutz GmbH
Düsseldorf, Bonn, Berlin
info@peutz.de
www.peutz.de

Peutz SARL
Paris, Lyon
Info@peutz.fr
www.peutz.fr

Peutz bv
London
info@peutz.co.uk
www.peutz.co.uk

Daidalos Peutz bvba
Leuven
Info@daidalospeutz.be
www.daidalospeutz.be

Köhler Peutz Geveltechniek bv
Zoetermeer
Info@gevel.com
www.gevel.com

All orders to our consultancy are accepted, carried out and charged in accordance with 'The New Rules 2005; Legal relationship client-architect, engineer and consultant' (DNR 2005)

BTW: NL004933837B01
KvK: 12028033

Principal: Rockwool International
Hovedgaden 584
DK-2640 Hedehusene
Denmark

Report number: A 2151-2E-RA

Date: 12 juli 2011

Ref.: TS/JK/AdB/A 2151-2E-RA

Index

	pagina
1. INTRODUCTION	3
2. STANDARDS	4
3. TESTED CONSTRUCTION	6
4. SOUND ABSORPTION MEASUREMENTS	7
4.1. Method	7
4.2. Accuracy	8
4.3. Atmospheric conditions	9
4.4. Results	9
5. AIRBORNE SOUND INSULATION MEASUREMENTS	11
5.1. Method	11
5.2. Accuracy	12
5.2.1. Repeatability r	12
5.2.2. Reproducibility R	12
5.2.3. Environmental conditions during the tests	13
5.3. Results	13

1. INTRODUCTION

At the request of RockDelta A/S based in Hedehusene (Denmark), laboratory measurements of the sound absorption and the sound insulation were carried out on a

noise barrier type NoiStop Green, manufacturer RockDelta A/S

in the Laboratory for Acoustics of Peutz bv, at Mook, The Netherlands (see figure 1).



For this type of measurements the Laboratory for Acoustics has been accredited by the Dutch “Stichting Raad voor Accreditatie” (RvA).

The RvA is member of the EA MLA¹

1 **EA MLA:** European Accreditation Organisation MultiLateral Agreement: <http://www.european-accreditation.org>

EA: “Certificates and reports issued by bodies accredited by MLA and MRA members are considered to have the same degree of credibility, and are accepted in MLA and MRA countries.”

2. STANDARDS

The measurements have been carried out according to the Quality Manual of the Laboratory for Acoustics as well as:

ISO 354:2003² Acoustics Measurement of sound absorption in a reverberation room

NOTE: this international standard has been accepted within all EU-countries as European Norm EN ISO 354:2003

ISO 140-3:1995 Acoustics - Measurements of sound insulation in buildings and of building elements: Part 3: Laboratory measurements of airborne sound insulation of building elements

NOTE: this international standard has been accepted within all EU-countries as European Norm EN ISO 140-3:1995

Various other related standards:

EN ISO 11654:1997 Acoustics Sound absorbers for use in buildings Rating of sound absorption

EN 1793-1:1997 Road traffic noise reducing devices Test method for determining the acoustic performance Part 1: Intrinsic characteristics of sound absorption

EN 1793-2:1997 Road traffic noise reducing devices - Test method for determining the acoustic performance - Part 2: Intrinsic characteristics of airborne sound insulation

EN 1793-3:1997 Road traffic noise reducing devices - Test method for determining the acoustic performance - Part 3: Normalised traffic noise spectrum

ISO 717-1:1996 Acoustics - Rating of sound insulation in buildings and of building elements - Part 1: Airborne sound insulation

N.B. De norm ISO 717-1 is binnen alle landen van de EG aanvaard als Europese Norm EN ISO 717-1:1996

2 According to this norm, the report should include for each measurement the mean reverberation times T1 and T2 at each frequency. Because these figures are not relevant for judging the quality of the product being tested, but merely for judging the accuracy of the calculations, they have been omitted in this report. It is possible of course to reproduce those figures at any time if the principal requests this.

ISO 717-1:1996/A1:2006

Acoustics - Rating of sound insulation in buildings and of building elements- Part 1: Airborne sound insulation - Amendment 1 : Rounding rules related to single number ratings and single number quantities

3. TESTED CONSTRUCTION

The data presented here have been received from the principal or obtained by own observations. The measurements have been carried out on a barrier, dimensions width x height 4000 x 2680.

Description of the tested noise barrier:

Make: RockDelta A/S
Type: NoiStop Green
Material: Rockwool core covered with a green perforated plastic foil and framed with a metal grid mesh width 150 x 150 mm.
Element thickness: 112 mm
Width: 2000 mm
Height: 900 mm
Weight: 27,0 kg/m² (measured)



detail NoiStop Green element

The test specimen is mounted and assembled in the same manner as the barrier is used in practice with the same connections and seals between the elements. In the centre one post is included in the specimen with elements attached on both sides.

The results as presented here relate only to the tested items and laboratory conditions as described in this report. The laboratory can make no judgement about the representativity of the tested samples.

4. SOUND ABSORPTION MEASUREMENTS

The barrier to be measured (see chapter 3) is placed directly onto the floor with the view side of the elements up, according to EN 1793-1. The sides of the set-up were enclosed by reflecting panels and sealed by tape. See also figure 3.

4.1. Method

The tests were conducted in accordance with the provisions of the test method ISO 354 in the reverberation room of "Peutz bv" in Mook (the Netherlands) (see figure 1). The relevant data regarding the reverberation room are given in figure 2 of this report.

By means of reverberation measurements the reverberation time of the room is measured under two conditions:

- when the reverberation room is empty
- when the construction under test is inside the reverberation room

In general, once material is placed into the reverberation room a lower reverberation time will result.

The difference in reverberation times is a measure of the amount of absorption brought into the room.

Measurements and calculations were carried out in 1/3-octave bandwidth from 100 to 5000 Hz, according to the norms. Where applicable the octave values have been calculated from these 1/3-octave values.

From the reverberation measurements in the empty reverberation room the equivalent sound absorption A_1 is calculated (per frequency band) according to formula 1 and expressed in m^2

$$A_1 = \frac{55,3 V}{c T_1} - 4 V m_1 \quad (1)$$

in which :

- | | | |
|-------|---|--------------|
| V | = the volume of the reverberation room | [m^3] |
| T_1 | = the reverberation time in the empty reverberation room | [sec.] |
| m_1 | = "power attenuation coefficient" in the empty room,
calculated according to formula | [m^{-1}] |
| c | = the speed of sound in the air, in m/s, calculated according to | [m/s] |

$$c = 331 + 0,6t \quad (2)$$

in which :

t = the temperature; this formula is valid for temperatures between 15 and 30 °C [°C]

$$m = \frac{\alpha}{10 \log(e)} \quad (3)$$

in which :

α = "attenuation coefficient" according to ISO 9613-1

In the same manner the equivalent sound absorption A_2 for the room with the test specimen is calculated according to formula 4, also expressed in m^2

$$A_2 = \frac{55,3 V}{c T_2} - 4 V m_2 \quad (4)$$

in which :

c and V have the same definition as in formula 1 and

T_2 = the reverberation time of the reverberation room with the test specimen placed inside [sec]

m_2 = "power attenuation coefficient" in the room with the test specimen placed inside, calculated according to formula 3 [m^{-1}]

The equivalent sound absorption A of the test specimen has been calculated according to formula 5 and is expressed in m^2

$$A = A_2 - A_1 \quad (5)$$

When the test specimen consists of one plane with an area between 10 and 12 m^2 the sound absorption coefficient α_s has to be calculated according to formula 6:

$$\alpha = \frac{A}{S} \quad (6)$$

in which:

S = the area of the test specimen [m^2]

4.2. Accuracy

The accuracy of the sound absorption as calculated can be expressed in terms of repeatability (tests within one laboratory) and reproducibility (between various laboratories).

When:

- two tests are performed on identical test material
- within a short period of time
- by the same person or team
- using the same instrumentation
- under unchanged environmental conditions

the probability will be 95% that the difference between the two test results will be less than or equal to r .

In order to evaluate the repeatability r for the sound absorption measurements performed in the reverberation room of "Peutz bv" in Mook (the Netherlands) eight series of measurements have been carried out according to ISO 354:1985 annex C. From the results of those measurements the repeatability r has been calculated. It was found that for the frequency range from 100 to 200 Hz and at 5000 Hz the repeatability r is 0,21 as a maximum. For the frequency range 250 to 4000 Hz the repeatability r is 0,09 as a maximum.

4.3. Atmospheric conditions

The atmospheric conditions during the measurements are presented in table 1 below.

Table 1 Atmospheric conditions during the test

reverberation room	temperature [°C]	atmospheric pressure [kPa]	relative humidity [%]
empty	19,7	102,3	51
With specimen	19,5	102,5	54

4.4. Results

The results of the measurements are given in table 2 and figure 4 and 5. The measurements were made in 1/3-octave bands. The results presented in octave-bands are the arithmetic average of the results of the three 1/3-octave bands belonging to that octaveband.

From those values the following one-figure ratings have been calculated and stated :

- the "weighted sound absorption coefficient α_w " according to ISO 11654
- the "Noise Reduction Coefficient NRC" according to ASTM-C423, being the average of the absorption coefficients (1/3 octave values) at the frequencies of 250, 500, 1000 and 2000 Hz, rounded to the nearest 0,05.
- the "single-number rating of sound absorption DL_α " according to EN 1793-1.

Table 2 Measurement results

type record nr. See figure	sound absorption coefficient α_s	
	NoiStop Green	
	#399	
frequency [Hz]	1/3 oct.	1/1 oct.
100	0,54	
125	0,56	0,59
160	0,66	
200	0,56	
250	0,71	0,67
315	0,75	
400	0,75	
500	0,82	0,81
630	0,87	
800	0,89	
1000	0,91	0,91
1250	0,94	
1600	0,94	
2000	0,96	0,96
2500	0,97	
3150	0,94	
4000	0,97	0,96
5000	0,96	
α_w	0,85	
NRC	0,85	
DL_α	9 dB	
Category	A3	

The sound absorption coefficient of a material is not a material property. It should be taken into account that the sound absorption of a construction depends on the dimensions, the way of mounting of the material and its position in the room.

5. AIRBORNE SOUND INSULATION MEASUREMENTS

The client built the test arrangement into the test opening D (c. 4300 x 2800 mm) between testing rooms 1 and 2. The test specimen is composed with 6 elements and a post in the center of the construction. The panels are attached on both sides of the post and sealed as in practice.

The edge supports are built with a wall construction of sufficient airborne sound insulation and sealed to prevent sound leakages.

5.1. Method

The tests were conducted in accordance with the provisions of the test method ISO 140-3 in the Laboratory for Acoustics of Peutz bv in Mook. A detailed description of the test set up has been given in figures 1 and 5 of this report.

The construction to be tested is placed into a test opening between two measuring rooms. In one of the rooms (the so-called sending room) loudspeakers generate broadband noise.

In this sending room as well as in the adjacent room (the "receiving room") the resulting sound pressure level is measured by means of a continuous rotating boom, so the (time- and space-) averaged sound pressure level is determined.

The reverberation time of the receiving room is also measured.

The instruments and the method used meet the requirements of ISO 140-3

As allowed by the test method the test procedure is repeat-ed reversing the sending and receiving rooms. The reported value of each sound insulation is the arithmetic average of the two results.

In ISO 140-3 the airborne sound insulation of an object is defined as the "sound reduction index R" to be evaluated according to formula 1 and expressed in dB:

$$R=L_1-L_2+10 \log\left(\frac{S}{A}\right) \quad (7)$$

in which:

L_1 = sound pressure level in the sending room [dB]

L_2 = sound pressure level in the receiving room [dB]

S = area of the object to be tested [m²]

A = equivalent sound absorption [m²] in the receiving room according to:

$$A = \frac{0,16 V}{T} \quad (8)$$

in which :

V = volume of the receiving room [m³]

T = reverberation time in the receiving room [s]

5.2. Accuracy

The accuracy of the airborne sound insulation as calculated can be expressed in terms of repeatability (tests within one laboratory) and reproducibility (between various laboratories).

5.2.1. Repeatability r

When: - two tests are performed on identical test material - within a short period of time - by the same person or team - using the same instrumentation - under unchanged environmental conditions - the probability will be 95% that the difference between the two test results will be less than or equal to r.

In order to evaluate the repeatability r for the sound insulation measurements performed in the laboratories of Peutz bv in Mook eight series of measurements have been carried out according to ISO 140-2. From the results of those measurements the repeatability r has been calculated. It was found that for the frequency range from 100 to 250 Hz the repeatability r is 2,0 dB as a maximum. For the frequency range 315 to 3150 Hz the repeatability r is 1,3 dB as a maximum.

The repeatability r regarding the single-figure rating R_w is 0,7 dB as a maximum. As ISO 717-1 prescribes rounding of the R_w -values to the nearest dB repeatability r of 1 dB is applicable for the R_w -value.

From these results it may be concluded that the repeatability r as found satisfies the demands of ISO 140-2.

5.2.2. Reproducibility R

When: - two tests are performed on identical test material - in different laboratories - by different person(s) - under different environmental conditions - the probability will be 95% that the difference between the two test results will be less than or equal to R.

In ISO 140-2 there is a statement on the reproducibility R to be expected, based on the results of various inter-laboratory tests. The reproducibility of the single figure rating R_w is about 3 dB.

5.2.3. Environmental conditions during the tests

Table 3 Atmospheric conditions during the test

room	temperature [°C]	relative humidity [%]
1	19,0	49
2	18,7	47

5.3. Results

The results of the measurements are given in table 4 and figure 7 to 8. In the table and graph the values of the insulation found are presented in 1/3 octave bands.

From those values the following one-figure ratings have been calculated and stated :

- the "weighted sound reduction index R_w " and the spectrum adaptation terms C and C_{tr} according to ISO 717-1;
- the single-number rating of airborne sound insulation DLR" according to EN 1793-2.

Tabel 4 Measurement results

type	airborne sound insulation R [dB]			
	NoiStop Green		Idem, + seams taped	
record nr.	#177		#184	
See figure	6		7	
frequency [Hz]	1/3 oct.	1/1 oct.	1/3 oct.	1/1 oct.
100	14,7		16,2	
125	12,5	13,1	13,7	14,4
160	12,5		13,7	
200	13,8		15,2	
250	14,2	14,3	15,9	15,9
315	15,0		16,9	
400	17,0		19,0	
500	16,1	16,4	16,9	17,5
630	16,3		17,0	
800	23,0		24,3	
1000	25,7	24,7	26,8	25,7
1250	26,1		26,4	
1600	32,2		32,9	
2000	33,3	33,6	34,4	34,8
2500	36,4		39,4	
3150	38,0		42,1	
4000	40,1	37,1	46,6	45,2
5000	34,8		51,5	
$R_w(C;C_{tr})$	23(-1;-3) dB		24(-1;-3) dB	
DL_R	20 dB(A)		21 dB(A)	
Category	B2		B2	

The results as presented here are based on a testing area of 10,7 m². In situations where different dimensions and/or method of mounting differ from the ones tested, different results may be found.

Mook,

Th. Scheers
Laboratory Supervisor


ir. M.L.S. Vercammen
Manager

This report contains: 14 pages and 7 figures.


PEUTZ bv
Lindenlaan 41, NL-6584 AC MOLENHOEK (LB), THE NETHERLANDS

OVERVIEW


Story

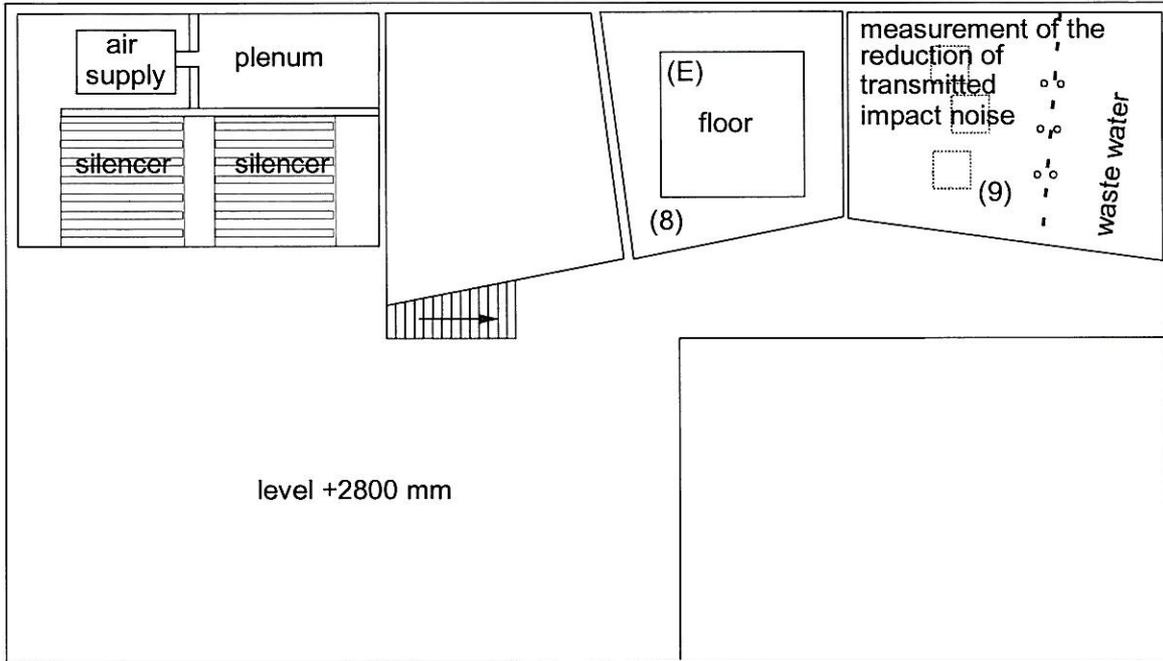

Ground level
opening (A) (closed)
w x h = 1300 x 1905 mm

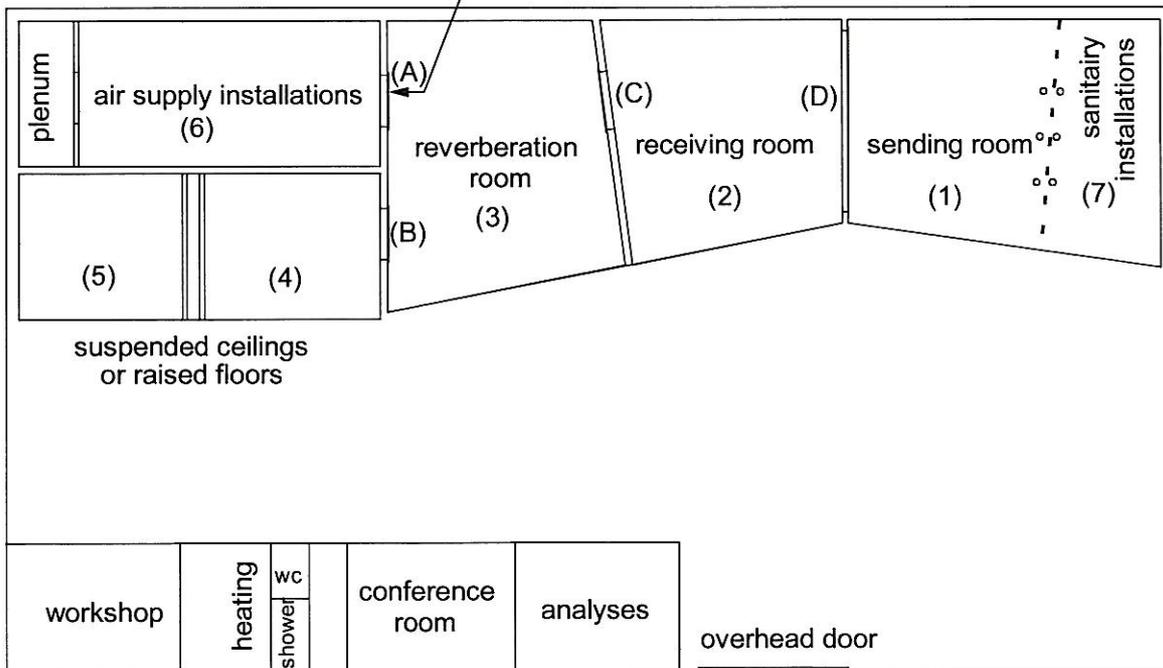

- TEST OPENINGS (w x h in mm)
- (B) 1000 x 2200
 - (C) 1500 x 1250
 - (D) 4300 x 2800
 - (E) 4000 x 4000



PEUTZ bv
Lindenlaan 41, 6584 AC MOLENHOEK (LB)

REVERBERATION ROOM

The reverberation room meets the requirements of ISO 354:2003.

additional data:

volume : 214 m³

total area S_t (walls, floor and ceiling) : 219 m²

diffusion: by the shape of the room and by adding 6 curved and 2 flat reflecting elements with a total area of approx. 13 m² a sufficient diffusion has been gained.


reverberation time of the empty reverberation room during measurements of 24-05-2011

frequentie (1/1 oct.)	125	250	500	1000	2000	4000	Hz
nagalmtijd	9,41	7,81	7,74	6,44	4,62	2,95	sec.

repeatability r (1/1 oct.) c.f. ISO 354:1985 annex C (see chapter 4.2 of this report).

r bij hoge α	0,13	0,04	0,04	0,02	0,02	0,08	-
r bij lage α	0,09	0,02	0,01	0,02	0,02	0,04	-

plan

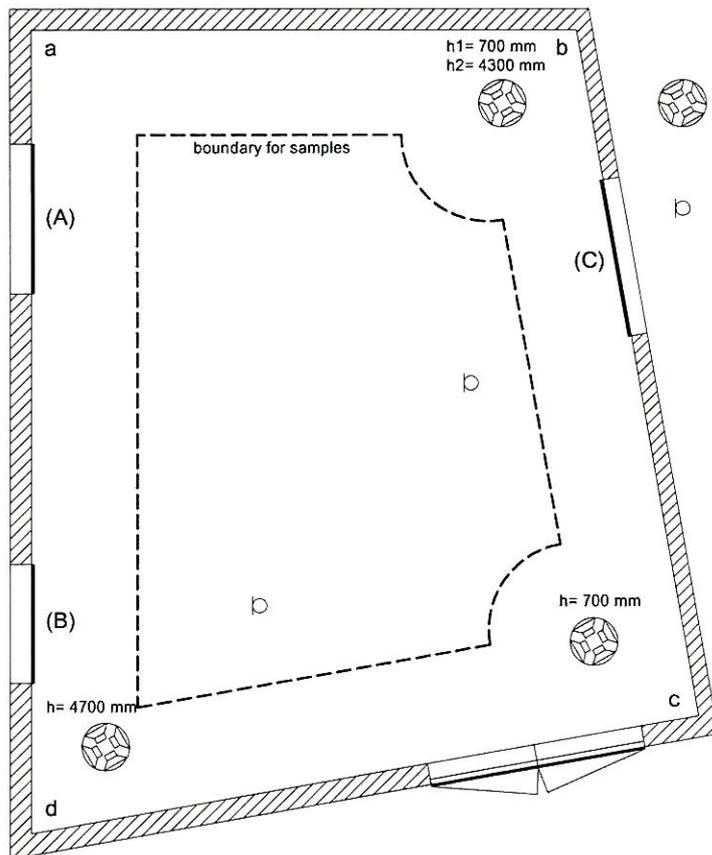

loudspeaker (4x)



microphone (3x)

(closed) testopenings
(width x height in mm)
(A): 1300 x 1800
(B): 1000 x 2200
(C): 1500 x 1250

height at:
a: 5573 mm
b: 5102 mm
c: 5000 mm
d: 5580 mm

0 1 2 m

Absorb, versie 5.6.2 mode 7, file: a2151 E#:109-144 T₁ = 19,7 °C p₁ = 102,3 kPa h₁ = 51,4 %

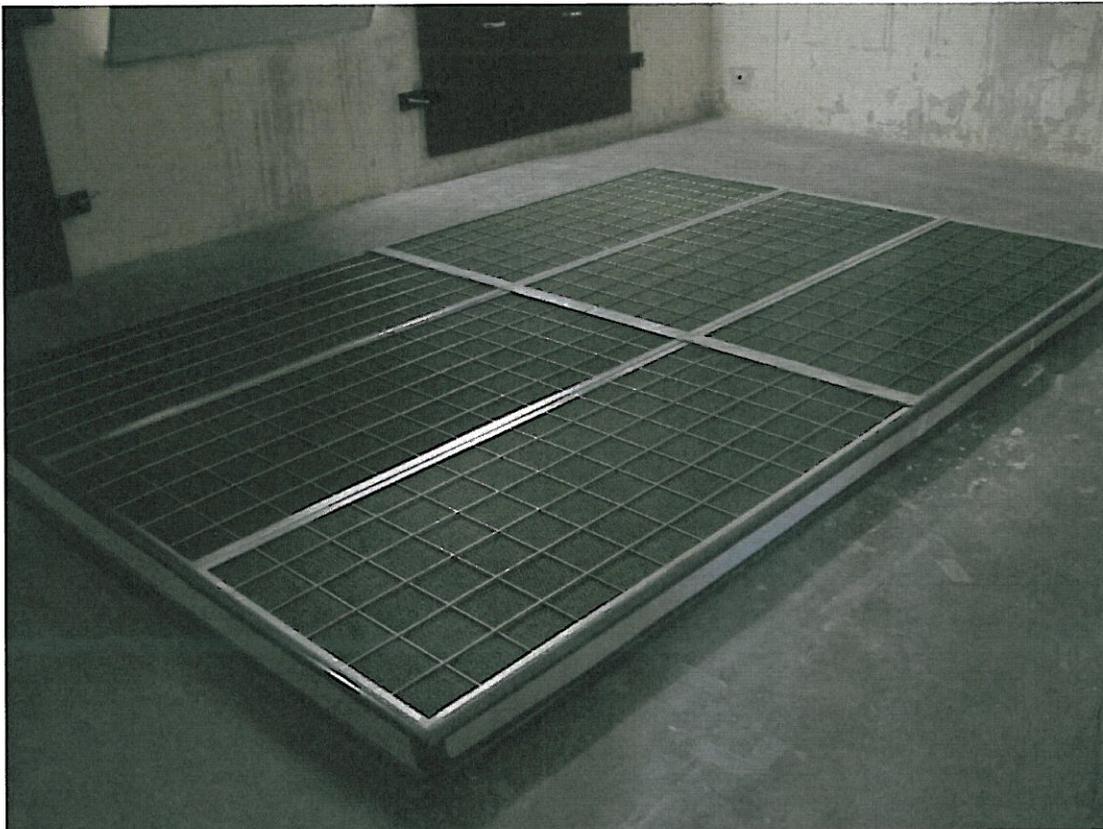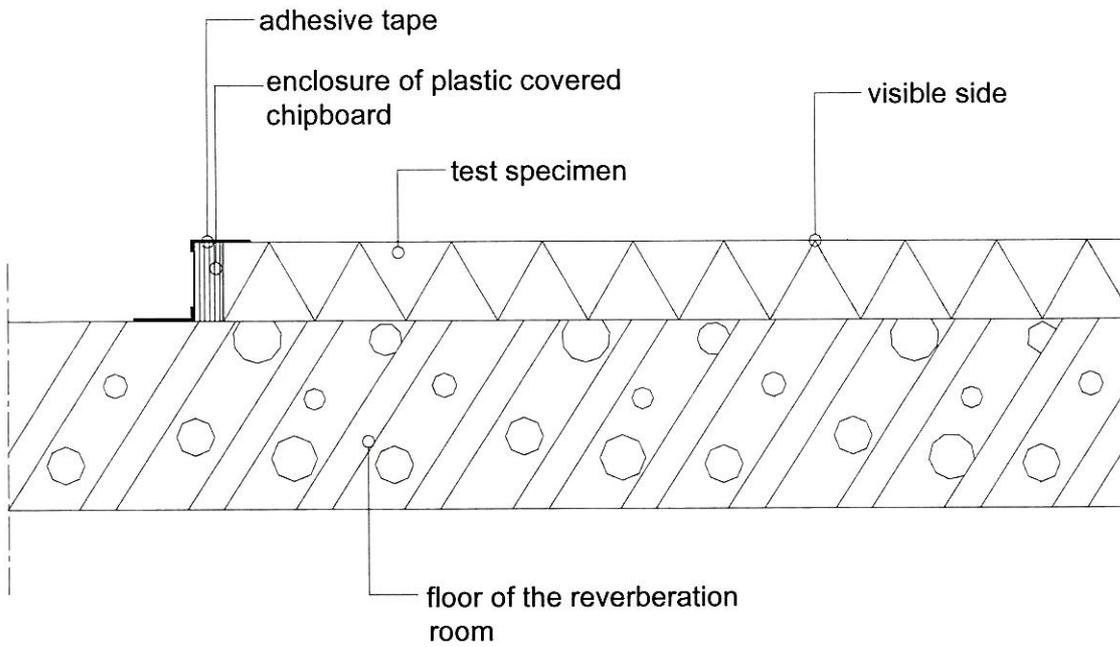


NoiStop Green

MEASUREMENT OF SOUND ABSORPTION IN A REVERBERATION ROOM
 ACCORDING TO ISO 354:2003



principal: RockDelta A/S

NoiStop Green

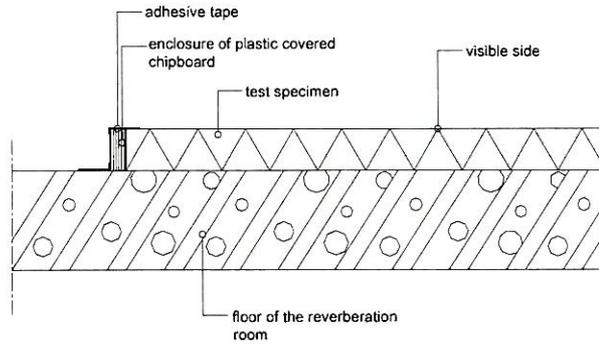

Absorb. v ersie 5.6.2 mode 7. PM: JK, file: a2151 E#: 363-398 F#: 255-290 A#: 399 T₁ = 19,6 °C T₂ = 19,2 °C p₁ = 102,8 kPa p₂ = 103,2 kPa h₁ = 53,0 % h₂ = 50,5 %

volume reverberation room: 214 m³

surface area sample: 10,8 m²

height of the construction: 0,11 m

measured at: laboratory conditions


signal: broad-band noise

bandwidth: 1/3 octave

α_w (ISO 11654) = 0,85

NRC (ASTM - C423) = 0,85

DL α (EN 1793-1) = 9 dB

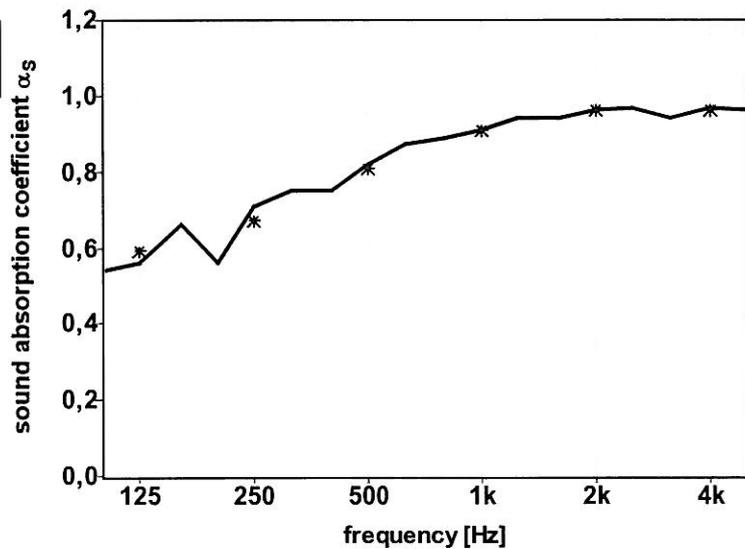

publication is permitted for the entire page only

Mook, 25-05-2011

PEUTZ bv
 Lindenlaan 41, 6584 AC MOLENHOEK (LB), HOLLAND

SOUND INSULATION TEST FACILITIES

The testrooms meet the requirements of ISO 140-3.



Additional data:

- volume of the receivingroom: 111 m³
- volume of the sourceroom: 94 m³
- area of the test specimen: 12,0 m²

Both rooms are isolated for vibrations by using a so called room-in-room construction. Flanking transmission is thus minimised.

height: along the walls 2840 mm increasing to 2920 mm at the perimeter of the testopening for floors

height at a: 3055 mm
 height at b: 3058 mm
 height at c: 3052 mm
 height at d: 3062 mm


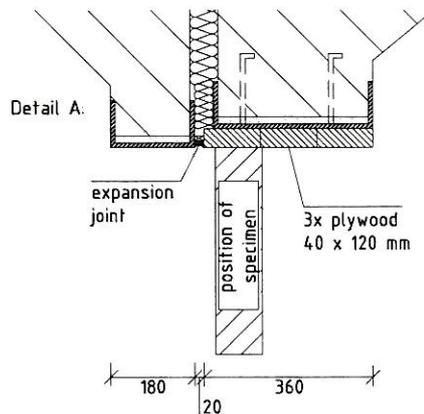
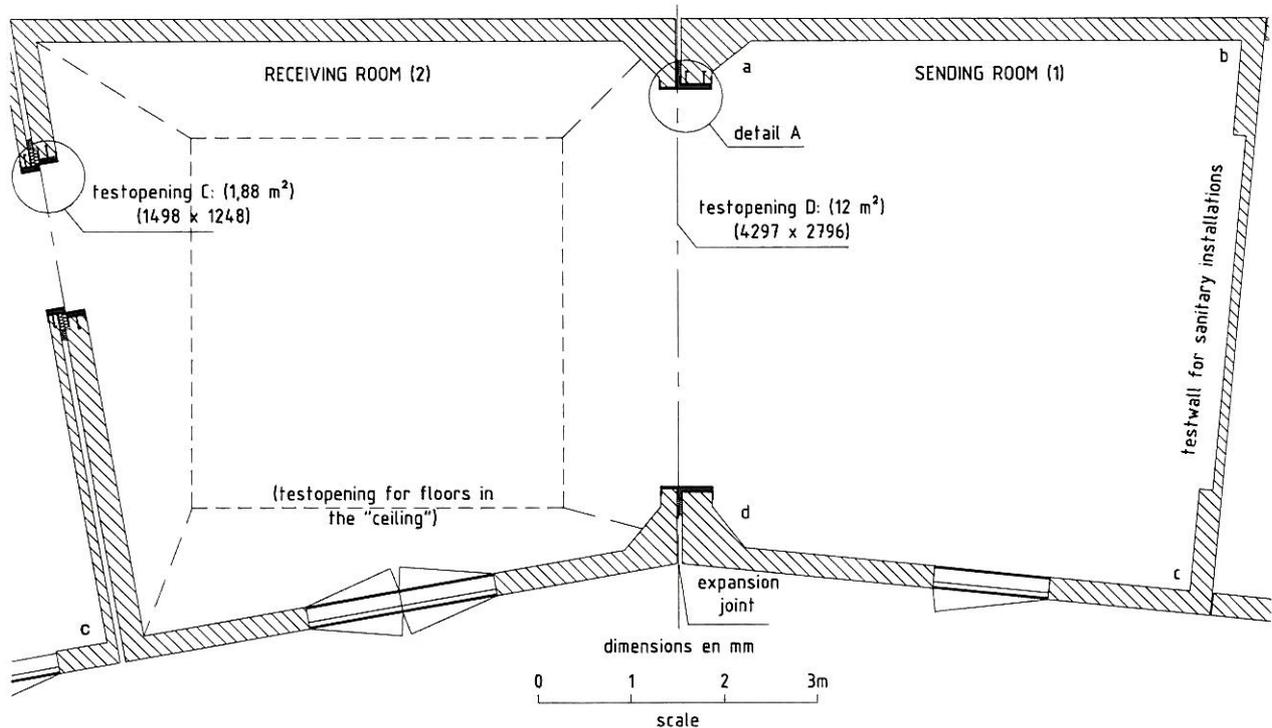


MEASUREMENT OF THE SOUND INSULATION ACCORDING TO ISO 140-3:1995



principal: RockDelta A/S

construction tested: #1; NoiStop Green

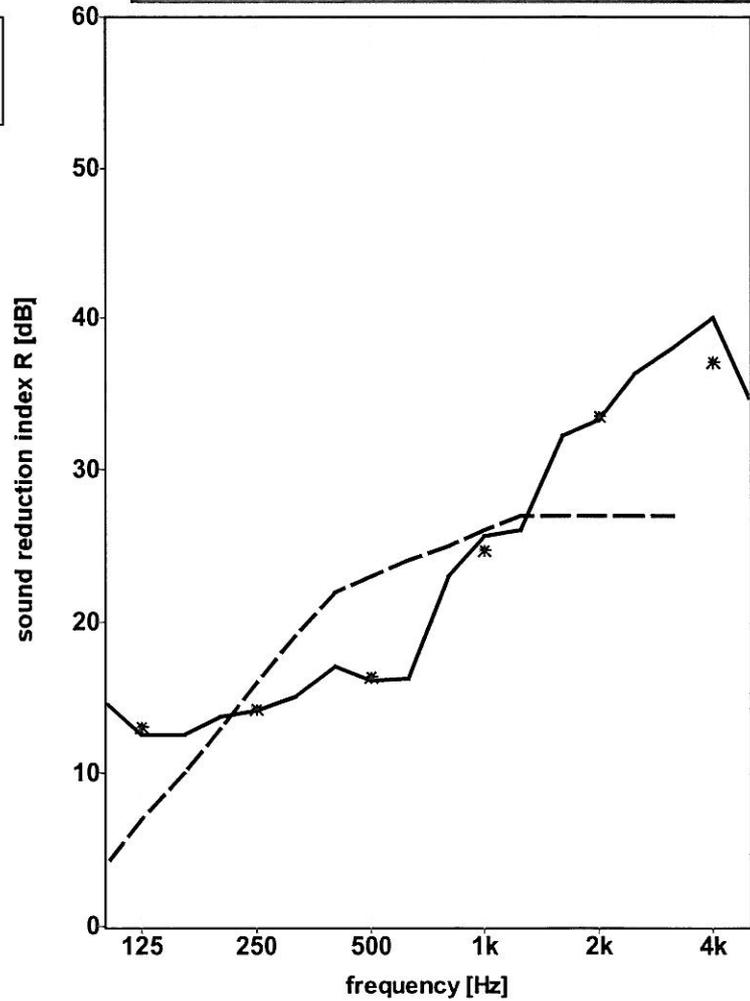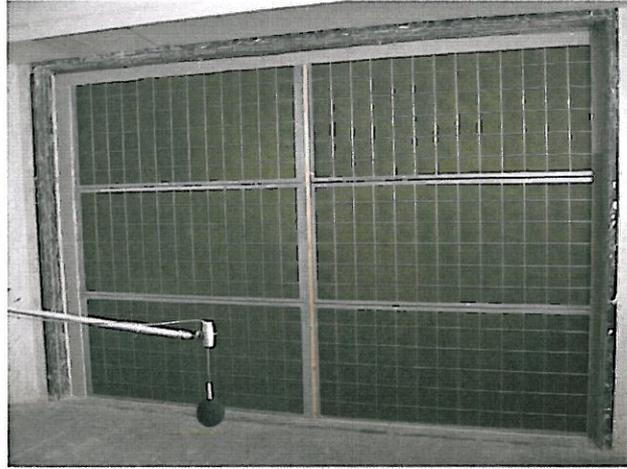

volume measuring room: 111 m³

volume measuring room: 94 m³

surface area tested partition: 11,1 m²

mass tested partition: 27,0 kg/m²

measured at:
Peutz Laboratory for Acoustics

signal: broad-band noise

bandwidth: 1/3 octave

ISO 717-1:1996

$$R_w(C;C_{tr}) = 23(-1;-3) \text{ dB}$$

EN 1793-2:1997

$$DL_R = 20 \text{ dB(A)}$$

	125	250	500	1k	2k	4k
1/3 oct.	14,7	13,8	17,0	23,0	32,2	38,0
	12,5	14,2	16,1	25,7	33,3	40,1
	12,5	15,0	16,3	26,1	36,4	34,8
1/1 oct.	13,1	14,3	16,4	24,7	33,6	37,1
						dB

Insulat rel. 3.6.3 mode 1. file: a2151 S#:175-176 ##:177

publication is permitted for the entire page only



Mook, 24-05-2011

MEASUREMENT OF THE SOUND INSULATION ACCORDING TO ISO 140-3:1995



principal: RockDelta A/S

construction tested: #2; NoiStop Green; naden getaped

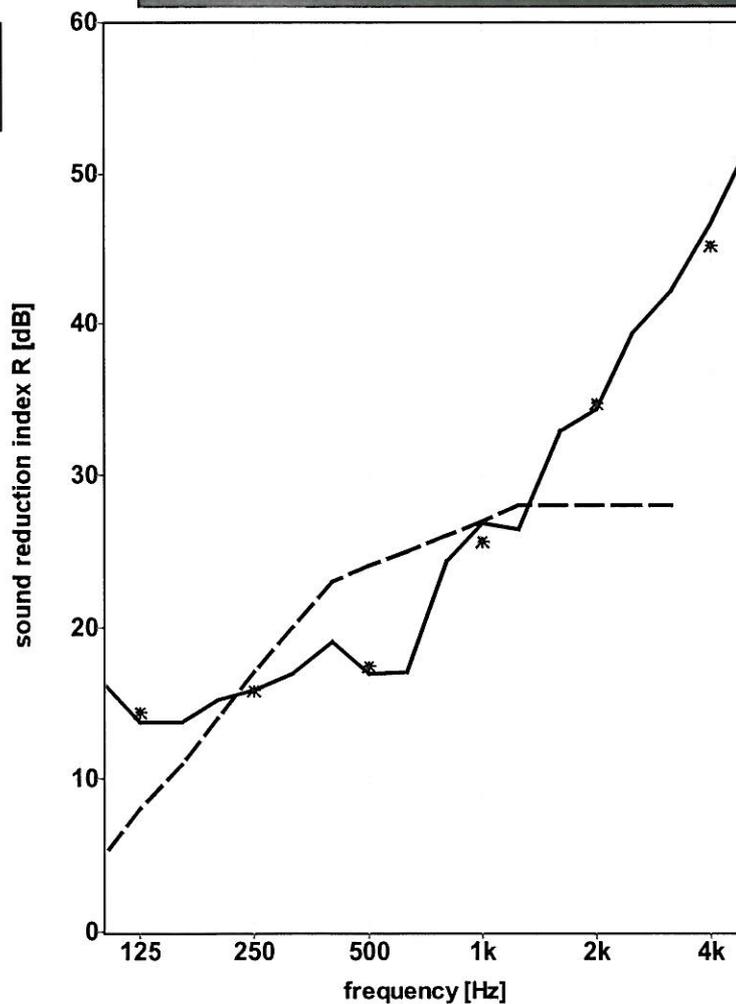

volume measuring room: 111 m³

volume measuring room: 94 m³

surface area tested partition: 11,1 m²

mass tested partition: 27,0 kg/m²

measured at:
Peutz Laboratory for Acoustics

signal: broad-band noise

bandwidth: 1/3 octave

ISO 717-1:1996

$$R_w(C; C_{tr}) = 24(-1;-3) \text{ dB}$$

EN 1793-2:1997

$$DL_R = 21 \text{ dB(A)}$$

	125	250	500	1k	2k	4k
1/3 oct.	16,2	15,2	19,0	24,3	32,9	42,1
	13,7	15,9	16,9	26,8	34,4	46,6
	13,7	16,9	17,0	26,4	39,4	51,5
1/1 oct.	14,4	15,9	17,5	25,7	34,8	45,2

Insulat rei. 3.6.3 mode 1. file: a2151 S#:182-183 ##:184

publication is permitted for the entire page only

Mook, 24-05-2011